



**MAHRLO**

## dTRANS T03 J, B, T Analog 2-wire transmitter with digital adjustment

## dTRANS T03 BU, TU Analog 3-wire transmitter with digital adjustment

for connection to Pt100 resistance thermometers

for installation in: - terminal head Form B to DIN 43 729  
- terminal head Form J

for mounting on: - rail



dTRANS T03 J  
Type 956530/...



dTRANS T03 B  
Type 956531/...



dTRANS T03 BU  
Type 956533/...

### Brief description

These transmitters are designed for industrial applications and are used to measure the temperature through Pt100 resistance thermometers in 2-/3-wire circuit connections.

The 4 — 20 mA or 0 — 10 V output signal is linear with temperature.

The continuous analog signal path enables an extremely fast reaction time of the output to a change in temperature (continuous analog measurement instead of digital sampling rate), resulting in a low-noise output signal that is insensitive to interference. A very high degree of precision - even with small ranges - is ensured thanks to the range-specific gain adjustment.

Digital communication allows the transmitter to be adapted to the measurement task (range, probe break and fine calibration).

Two versions are available to suit specific requirements:

#### Instruments with basic type extension 880/990 (adjustable)

The transmitters are calibrated for a fixed range but can, at any time, be calibrated for a different range through the PC setup program.

#### Instruments with basic type extension 881/991 (configurable)

The required range can be configured through the PC setup program, without sensor simulation and measurement.

### Overview of function

	dTRANS T03 J Type 956530/...	dTRANS T03 B Type 956531/...	dTRANS T03 T Type 956532/...	dTRANS T03 BU Type 956533/...	dTRANS T03 TU Type 956534/...
Input	Pt100	Pt100	Pt100	Pt100	Pt100
Connection circuit	2-wire	2- / 3-wire	2- / 3-wire	2- / 3-wire	2- / 3-wire
Mounting	terminal head Form J	terminal head Form B	rail	terminal head Form B	rail
Output	4 — 20mA	4 — 20mA	4 — 20mA	0 — 10V	0 — 10V



dTRANS T03 T  
Type 956532/...



dTRANS T03 TU  
Type 956534/...

**MAHRLO s.r.o.**

L'udmily Podjavorinskej 535/11  
916 01 Stará Turá

mob.: +421 908 170 313

tel.: +421 32 776 03 62

fax: +421 32 776 21 56

web: [www.mahrlo.sk](http://www.mahrlo.sk)

e-mail: [slecka@mahrlo.sk](mailto:slecka@mahrlo.sk)

e-shop: [priemyselne.eshopmahrlo.sk](http://priemyselne.eshopmahrlo.sk)

# Technical data for 2-wire transmitter (Types 956530/..., 956531/... and 956532/...)

## Input for resistance thermometer

	dTRANS T03 J Type 956530/...	dTRANS T03 B Type 956531/...	dTRANS T03 T Type 956532/...
Measurement input		Pt100 (EN 60 751)	
Range limits		-200 to +850°C	
Connection circuit	2-wire circuit	2-/3-wire circuit	2-/3-wire circuit
Smallest span		25 °C	
Largest span		1050 °C	
Unit		°C or °F	
Zero shift	for spans < 75°C fixed zero: -40°C, -20°C, 0°C, 20°C, 40°C		
		for span 75°C: ±50°C	
		for spans > 75°C: see "Range organization" on page 7	
Sensor lead resistance for 3-wire connection		≤ 11Ω per conductor	
Sensor lead resistance for 2-wire connection		factory-set: 0 Ω lead resistance settable through PC setup program	
Sensor current		≤ 0.5mA	
Sampling rate		continuous measurement because of analog signal path	

## Measurement circuit monitoring to NAMUR recommendation NE43

Underrange	falling to ≤ 3.6mA
Overrange	rising to ≥ 22mA to < 28mA (typically 24mA)
Probe short-circuit	≤ 3.6mA
Probe and lead break	positive: ≥ 22mA to < 28mA (typically 24mA) negative: ≤ 3.6mA

## Output

Output signal	proportional DC current 4 — 20mA
Transfer characteristic	linear with temperature
Transfer accuracy	≤ ± 0.1%
Damping of ripple on supply voltage	> 40dB
Burden (Rb)	Rb = (Ub - 7.5V) / 22mA
Burden error	≤ ± 0.02% / 100Ω <sup>1</sup>
Settling time on a temperature change	≤ 10msec
Calibration conditions	24V DC / approx. 22°C
Calibration/configuration accuracy	≤ ± 0.2% <sup>1,2</sup> or ≤ ± 0.2°C <sup>2</sup>

## Supply voltage

Supply voltage (Ub)	7.5 — 30V DC
Reverse polarity protection	yes
Supply voltage error	≤ ± 0.01% per V deviation from 24V <sup>1</sup>

<sup>1</sup> All details refer to the range-end value 20mA

<sup>2</sup> The larger value applies

## Ambient conditions

	dTRANS T03 J Type 956530/...	dTRANS T03 B Type 956531/...	dTRANS T03 T Type 956532/...
Operating temperature range	-40 to +85 °C	-40 to +85 °C	-25 to +70 °C
Storage temperature range		-40 to +100 °C	
Temperature error		$\leq \pm 0.01\%$ per °C deviation from 22 °C <sup>1</sup>	
Climatic conditions		rel. humidity $\leq 95\%$ annual mean, no condensation	
Vibration strength	to GL Characteristic 2	to GL Characteristic 2	-
EMC		EN 61 326 Class B to industrial requirements	
- interference emission			
- immunity to interference			
IP enclosure protection	IP54 / IP00	IP54 / IP00	-
- in terminal head / open mounting	-	-	IP20
- on C-rail			


<sup>1</sup> All details refer to the range-end value 20mA

## Housing


	Type 956530/...	Type 956531/...	Type 956532/...
Material	polycarbonate (encapsulated)	polycarbonate (encapsulated)	polycarbonate
Screw terminal	$\leq 1.5\text{ mm}^2$ ; max. torque 0.15 Nm	$\leq 1.75\text{ mm}^2$ ; max. torque 0.6 Nm	$\leq 2.5\text{ mm}^2$ ; max. torque 0.6 Nm
Mounting	inside terminal head Form J	inside terminal head Form B DIN 43 729; in surface-mounting case (on request); in switch cabinet (fixing bracket is required)	on C-rail 35mm x 7.5mm (EN 50 022); on C-rail 15mm (EN 50 045); on G-rail (EN 50 035)
	use only original accessories for mounting!		
Operating position	unrestricted		
Weight	approx. 12g	approx. 45g	approx. 70g

## System diagrams for 2-wire transmitter

### Connection example with supply unit

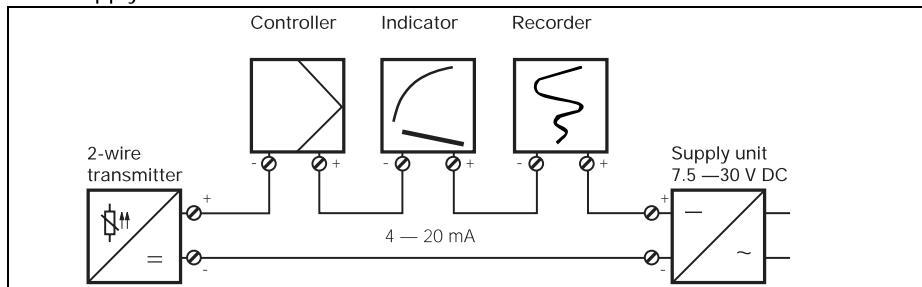

### Connection example with supply isolator

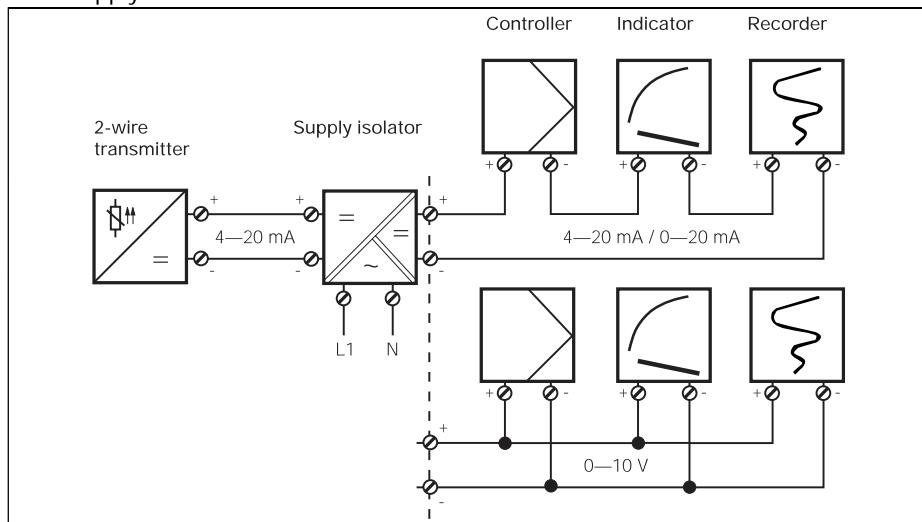

# Technical data for 3-wire transmitter (Types 956533/..., and 956534/...)

## Input for resistance thermometer

	dTRANS T03 BU Type 956533/...	dTRANS T03 TU Type 956534/...
Measurement input	Pt100 (EN 60 751)	
Range limits	-200 to +850 °C	
Connection circuit	2-/3-wire circuit	
Smallest span	40 °C	
Largest span	1050 °C	
Unit	°C or °F	
Zero shift	for spans < 75 °C fixed zero: -40 °C, -20 °C, 0 °C, 20 °C, 40 °C	
	for span 75 °C: ±50 °C	
	for spans > 75 °C: see "Range organization" on page 7	
Sensor lead resistance for 3-wire connection	≤ 11 Ω per conductor	
Sensor lead resistance for 2-wire connection	factory-set: 0 Ω lead resistance, settable through PC setup program	
Sensor current	≤ 0.5 mA	
Sampling rate	continuous measurement because of analog signal path	

## Measurement circuit monitoring to NAMUR recommendation NE43

Underrange	0 V
Overrange	rising to > 11 V to < 14 V (typically 12 V)
Probe short-circuit	0 V
Probe and lead break	positive: rising to > 11 V to < 14 V (typically 12 V) negative: 0 V

## Output

Output signal	DC voltage 0 — 10 V
Transfer characteristic	linear with temperature
Transfer accuracy	≤ ± 0.2 %
Damping of ripple on supply voltage	> 40 dB
Load	≥ 10 kΩ
Load error	≤ ± 0.1 %
Settling time on a temperature change	≤ 10 msec
Calibration conditions	24 V DC / approx. 22 °C
Calibration/configuration accuracy	≤ ± 0.2 % <sup>1,2</sup> or ≤ ± 0.2 °C <sup>2</sup>

## Supply voltage

Supply voltage (Ub)	15 — 30 V DC
Reverse polarity protection	yes
Supply voltage error	≤ ± 0.01 % per V deviation from 24 V <sup>1</sup>

<sup>1</sup> All details refer to the range-end value 10 V

<sup>2</sup> The larger value applies

## Ambient conditions

	dTRANS T03 BU Type 956533/...	dTRANS T03 TU Type 956534/...
Operating temperature range	-40 to +85 °C	-25 to +70 °C
Storage temperature range		-40 to +100 °C
Temperature error		$\leq \pm 0.01\%$ per °C deviation from 22 °C <sup>1</sup>
Climatic conditions		rel. humidity $\leq 95\%$ annual mean, no condensation
Vibration strength	to GL Characteristic 2	-
EMC		EN 61 326 Class B to industrial requirements
- interference emission		
- immunity to interference		
IP enclosure protection	IP54 / IP00	-
- in terminal head / open mounting	-	IP20
- on C-rail		


<sup>1</sup> All details refer to the range-end value 10V

## Housing

	Type 956533/...	Type 956534/...
Material	polycarbonate (encapsulated)	polycarbonate
Screw terminal	$\leq 1.75\text{ mm}^2$ ; max. torque 0.6 Nm	$\leq 2.5\text{ mm}^2$ ; max. torque 0.6 Nm
Mounting	inside terminal head Form B DIN 43 729; in surface-mounting case (on request); in switch cabinet (fixing bracket is required)	on C-rail 35mm x 7.5mm (EN 50 022); on C-rail 15mm (EN 50 045); on G-rail (EN 50 035)
use only original accessories for mounting!		
Operating position	unrestricted	
Weight	approx. 45g	approx. 70g

## System diagram for 3-wire transmitter

### Connection example

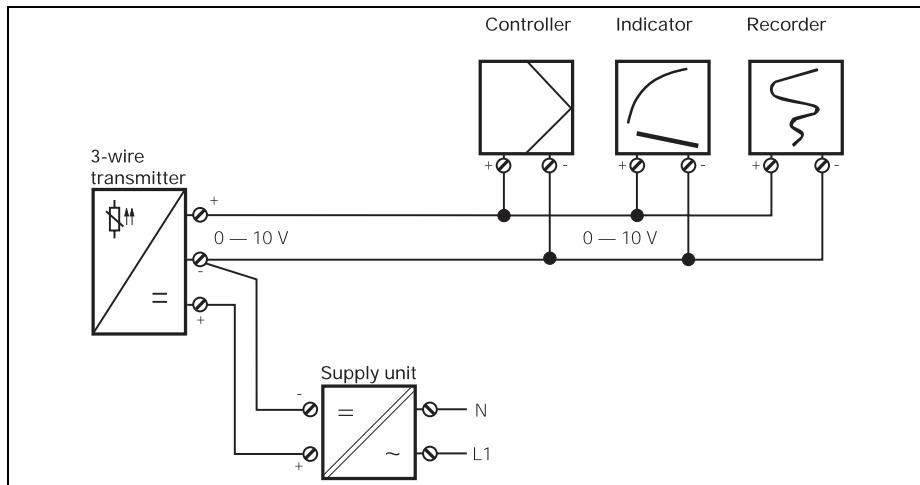

# Setup program (for all types)

The setup program is available for calibrating/configuring the transmitter from a PC.

Connection is through a PC interface (including power supply and adapter) and the setup interface of the transmitter. In order to calibrate/configure the transmitter, it has to be connected to the supply voltage. If no power supply or supply isolator is available, Types 956530/..., 956531/... and 956532/... can be supplied from a 9V block battery.

## Adjustable/configurable parameters

- TAG number (8 characters)
- response to probe and cable break
- range start, range end
- lead resistance for 2-wire circuit

## Fine calibration


Fine calibration means adjustment of the output signal of a calibrated/configured transmitter. Errors due to the system (such as an unfavorable probe installation) can be compensated. The signal can be adjusted in the range  $\pm 0.2\text{mA}$  for current output and  $\pm 0.1\text{V}$  for voltage output. Negative output voltages are not possible with voltage output. Fine calibration can only be carried out through the setup program.

## Hardware and software requirements

The following hardware and software requirements have to be met for installing and operating the setup program:

- IBM-PC or compatible PC from 486DX-2-100
- 64 MB main memory
- 10MB available on hard disk
- CD-ROM drive
- 1 free serial interface
- Win 98, ME or Win NT4.0, 2000, XP

## Connection layout for calibrating/configuring the dTRANS T03 B and BU

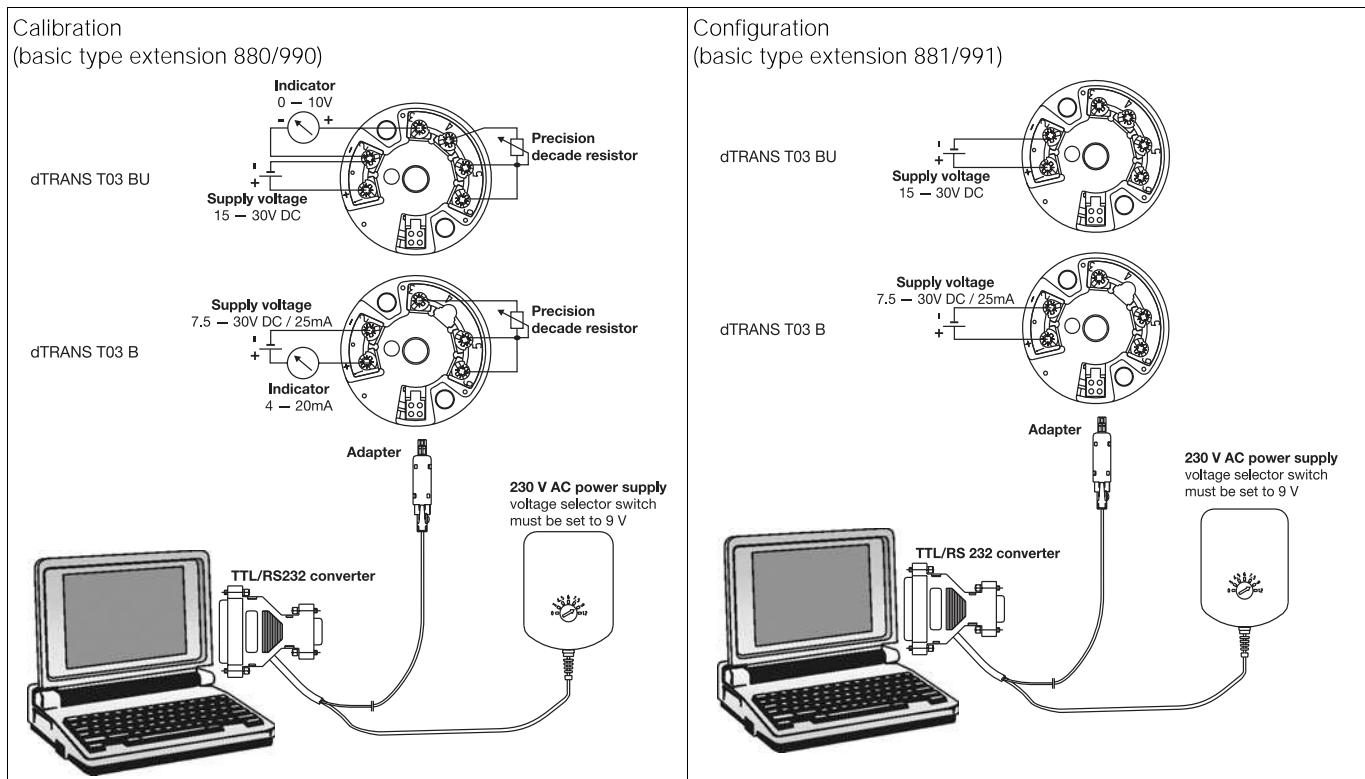

## Connection diagram for 2-wire transmitter

dTRANS T03 J - Type 956530/...

	Connection for		Terminal assignments	
	Supply voltage 7.5 — 30V DC	Current output 4 — 20mA	+1 -2	$R_B = \frac{U_b - 7.5V}{22mA}$ $R_B$ = burden resistance $U_b$ = supply voltage
<b>Analog inputs</b>				
	Resistance thermometer in 2-wire circuit	3 4	standard is $R_L = 0\Omega$	3 4

dTRANS T03 B - Type 956531/...

	Connection for		Terminal assignments	
	Supply voltage 7.5 — 30V DC	Current output 4 — 20mA	+1 -2	$R_B = \frac{U_b - 7.5V}{22mA}$ $R_B$ = burden resistance $U_b$ = supply voltage
<b>Analog inputs</b>				
	Resistance thermometer in 2-wire circuit	3 5 6	standard is $R_L = 0\Omega$	3 5 6
	Resistance thermometer in 3-wire circuit	3 5 6	$R_L \leq 11\Omega$ $R_L$ = lead resistance per conductor	3 5 6

dTRANS T03 T - Type 956532/...

	Connection for		Terminal assignments	
	Supply voltage 7.5 — 30V DC	Current output 4 — 20mA	+81 -82	$R_B = \frac{U_b - 7.5V}{22mA}$ $R_B$ = burden resistance $U_b$ = supply voltage
<b>Analog inputs</b>				
	Resistance thermometer in 2-wire circuit	11 12 13	standard is $R_L = 0\Omega$	11 12 13
	Resistance thermometer in 3-wire circuit	11 12 13	$R_L \leq 11\Omega$ $R_L$ = lead resistance per conductor	11 12 13

## Connection diagram for 3-wire transmitter

dTRANS T03 BU - Type 956533/...


Setup	Connection for		Terminal assignments	
	Supply voltage 15 — 30V DC	+1 -2		1 — +
Analog inputs		Voltage output 0 — 10V	-2 +3	load $\geq 10\text{k}\Omega$
	Resistance thermometer in 2-wire circuit	4 5 6	standard is $R_L = 0\Omega$	4 5 6
	Resistance thermometer in 3-wire circuit	4 5 6	$R_L \leq 11\Omega$ $R_L$ = lead resistance per conductor	4 5 6

dTRANS T03 TU - Type 956534/...


Setup	Connection for		Terminal assignments	
	Supply voltage 15 — 30V DC	+81 -82		81 — 83
Analog inputs		Voltage output 0 — 10V	-82 +83	load $\geq 10\text{k}\Omega$
	Resistance thermometer in 2-wire circuit	11 12 13	standard is $R_L = 0\Omega$	11 12 13
	Resistance thermometer in 3-wire circuit	11 12 13	$R_L \leq 11\Omega$ $R_L$ = lead resistance per conductor	11 12 13

## Dimensions

dTRANS T03 J

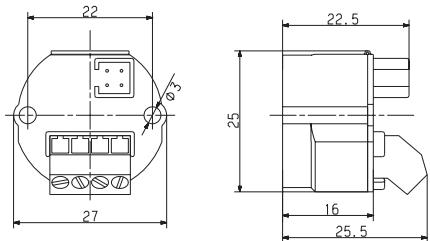


dTRANS T03 B and dTRANS T03 BU

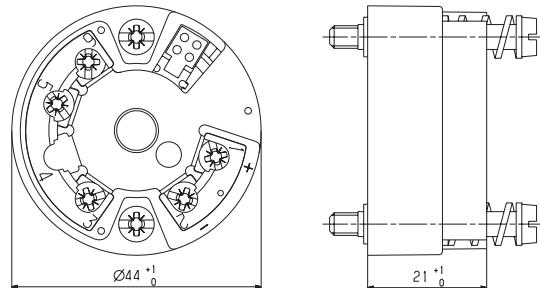


dTRANS T03 T and dTRANS T03 TU


C-rail 35mm x 7.5mm EN 50 022

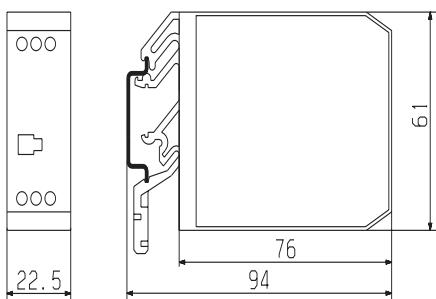

C-rail 15mm EN 50 045



G-rail EN 50 035



**MAHROL****Order details:** dTRANS T03

Analog transmitter with digital adjustment

## (1) Basic version

956530 dTRANS T03 J  
analog 2-wire transmitter  
for installation in terminal head Form J  
(2-wire circuit only)

956531 dTRANS T03 B  
analog 2-wire transmitter  
for installation in terminal head Form B

956532 dTRANS T03 T  
analog 2-wire transmitter  
for rail mounting

956533 dTRANS T03 BU  
analog 3-wire transmitter  
for installation in terminal head Form B

956534 dTRANS T03 TU  
analog 3-wire transmitter  
for rail mounting

## (2) Basic type extensions

- |             |     |   |
|-------------|-----|---|
| x x x x x x | 880 | adjustable,<br>factory-set (probe break: positive; lead resistance: 0Ω)           |
| x x x x x x | 990 | adjustable,<br>setting to customer specification (please specify in plain text)   |
| x x x x x x | 881 | configurable,<br>factory-set (probe break: positive; lead resistance: 0Ω)         |
| x x x x x x | 991 | configurable,<br>setting to customer specification (please specify in plain text) |

## (3) Input

- |             |     |                         |
|-------------|-----|-------------------------|
| x x x x x x | 001 | Pt100 in 3-wire circuit |
| x x x x x x | 003 | Pt100 in 2-wire circuit |

## (4) Output

- |             |     |          |
|-------------|-----|----------|
| x x x x x x | 005 | 4 — 20mA |
|             | 040 | 0 — 10V  |

Order code

└─	(1)	/	(2)	-	(3)	-	(4)
----	-----	---	-----	---	-----	---	-----

Order example

956531 / 880 - 001 - 005

**Standard accessories**

- Operating Instructions
- Fixing items

**Accessories**

- PC setup program, multilingual
- PC interface cable (isolated) with TTL/RS232 converter, power supply (230V AC) and adapter
- Supply units 1-way and 4-way (Data Sheet 95.6024)
- Isolating amplifier and supply isolator (Data Sheet 95.6055)
- Supply unit for transmitters (Data Sheet 95.6056)
- Fixing bracket for mounting Type 956531/... and Type 956533/... on rail, Sales No. 00352463

**MAHROL s.r.o.**Ľudmily Podjavorinskej 535/11  
916 01 Stará Turá

mob.: +421 908 170 313

tel.: +421 32 776 03 62  
fax: +421 32 776 21 56web: [www.mahrlo.sk](http://www.mahrlo.sk)e-mail: [slecka@mahrlo.sk](mailto:slecka@mahrlo.sk)e-shop: [priemyselne.eshopmahrlo.sk](http://priemyselne.eshopmahrlo.sk)